

MPS Catalog Number

H2 9C 20 035 MX SS 018

Date 7/14/2014

_____ End Fittings _____

Tower End Fitting: _____ Gain / 12 deg / Ductile Iron

Line End Fitting _____ 5" Bolt Circle / Galv. Ductile Iron
Trunnion / Galv. Ductile Iron

_____ Material _____

Corona Ring (Line) _____ None

Corona Rings are recommended for applications of 230 kV and above

Mounting Angle _____ 12

Number of Sheds _____ 18

Rod Diameter _____ 2.5 in

Weight Estimate _____ 52.6 lbs _____ 24 kg

_____ Dimensional Values _____

Section Length (L): _____ 46.8 in 1190 mm

Rubber Length (X): _____ 35 in

Shed spacing (S): _____ 2.0 in 50 mm

Shed Projection (P): _____ 1.6 in 41 mm

Dry Arc Distance _____ 37.3 in 947 mm

Leakage Distance _____ 95.6 in 2427 mm

_____ Electricals Values _____

60 Hz dry Flashover _____ 360 kV _____ Min. Withstand _____ 338 kV

60 Hz Wet Flashover _____ 333 kV _____ Min. Withstand _____ 260 kV

Pos. Critical Impulse Flashover _____ 618 kV _____ Min. Withstand _____ 553 kV

Neg. Critical Impulse Flashover _____ 705 kV _____ Min. Withstand _____ 590 kV


_____ Mechanical Values _____

Max. Design Cant. Load (MDCL) _____ 2,063 lbs _____ 9.2 kN

Specified Cant. Load (SCL) _____ 4,126 lbs _____ 18.4 kN

Specified Tensile Load (STL) _____ 5,000 lbs _____ 22.2 kN

This drawing contains confidential information that is the property of MacLean Power, L.L.C. ("MacLean"). Use of MacLean's confidential information without MacLean's express written consent is strictly prohibited and may expose you to legal liability. If you believe that you received this material in error, please destroy it or return it to "MacLean Power, L.L.C., 7801 Park Place Rd., York, South Carolina 29745, USA."

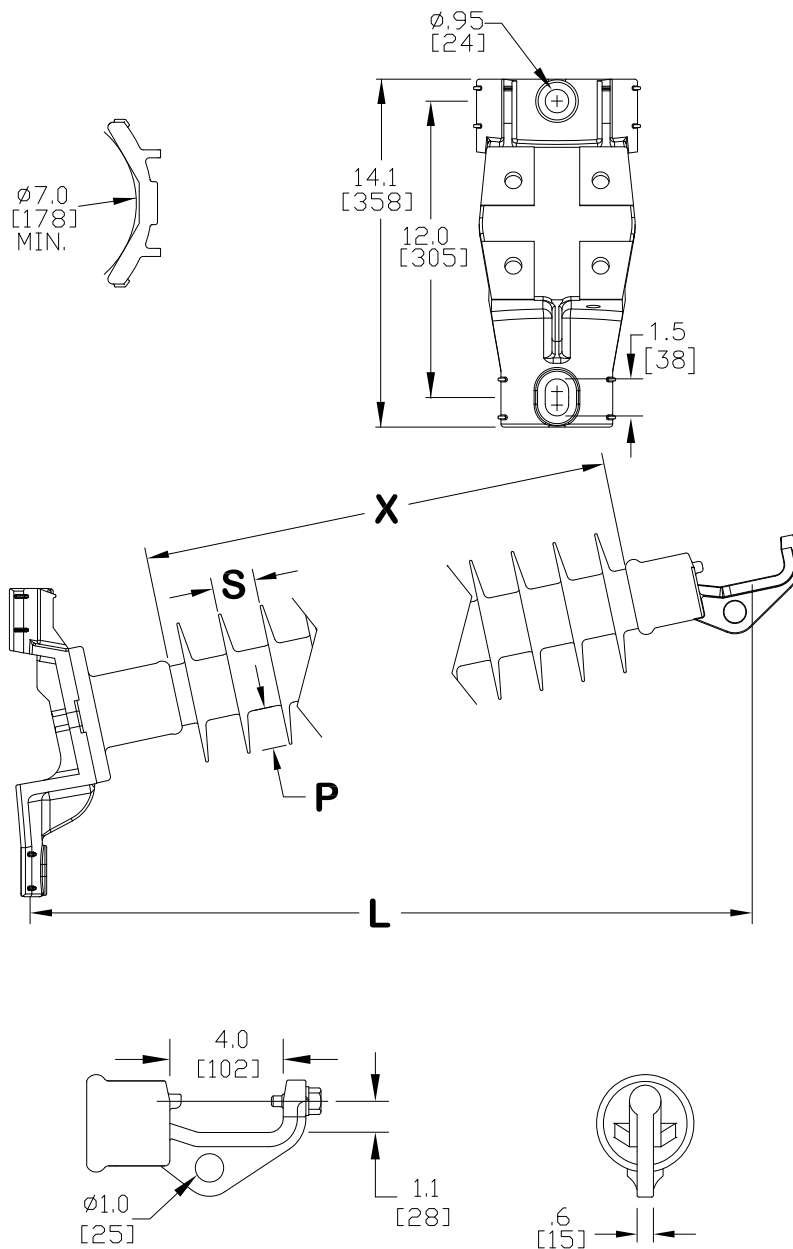

Dimension: inches [millimeters]

NOTE: Drawing not actual depiction of insulator appearance

Silicone Rubber Sheath & Sheds. Complies with applicable ANSI and IEC standards.